









Congratulations on your purchase of EchoStreams DSS224S-UN Storage Server System!

1. Check the Content of the box. Please confirm that your package contains the following:


| # | Description | Image / Description | Qty |
|---|-------------------------|---|-------|
| 1 | DSS224S-UN Enclosure |  | 1 |
| 2 | Motherboard | Tyan UP motherboard | 2 |
| 3 | CPU and memory | AMD EPYC and DDR4 | Opt. |
| 4 | IO Cards |  | Opt. |
| 5 | Heatsink |  | 2 |
| 6 | Slide Rail Kit + Screws |  | 1 set |
| 7 | Power Cable* |  | 2 |
| 8 | Serial Cable* |  | 1 |

* Inside the accessories box. Box may consist of screw sets for rail kit or drives. If any items are missing, please contact your reseller or sales rep.


2. Get Familiar with the Unit.

DSS224S-UN is a redundant server supporting single AMD EPYC processor with a front 24x 2.5" HDD storage in a 2U space. Two Tyan S8026 motherboards, and internal cabling are preinstalled. Other motherboard model, IO cards, CPU, and memory can be preinstalled upon request.


Front View of the Unit

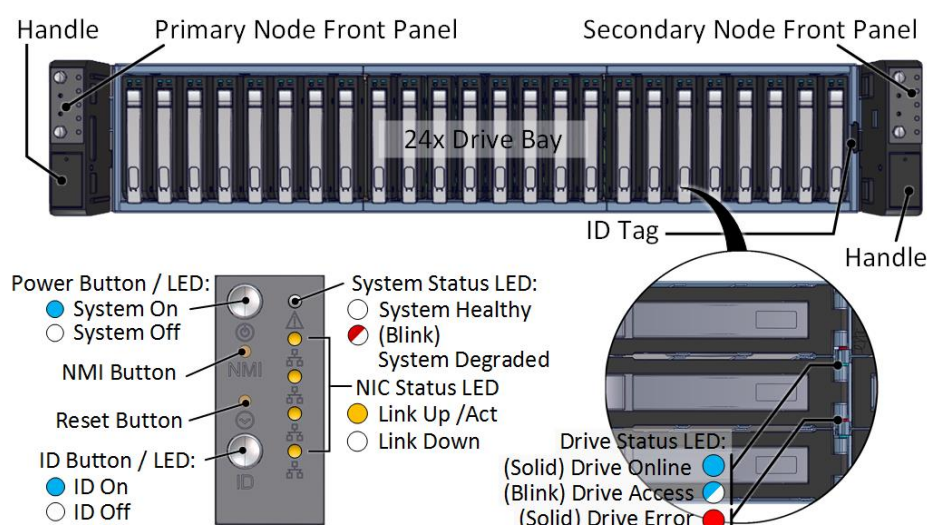


Rear View of the Unit

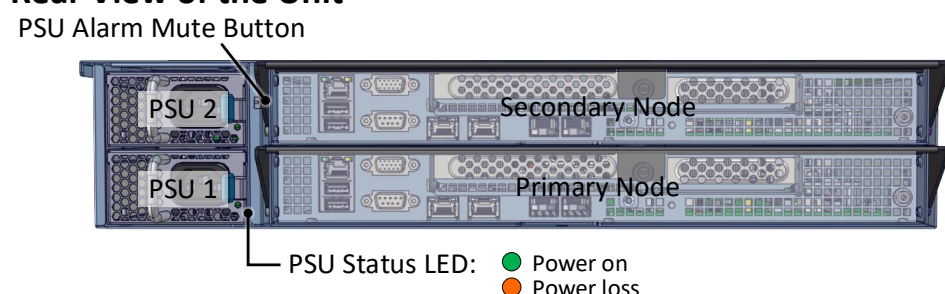


Controller Node

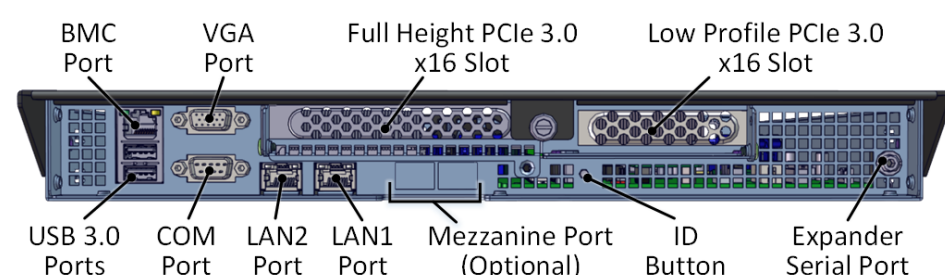


3. Install 2.5" Drives to the unit as illustrated. It is suggested to install HDDs after the unit is mounted to the rack.

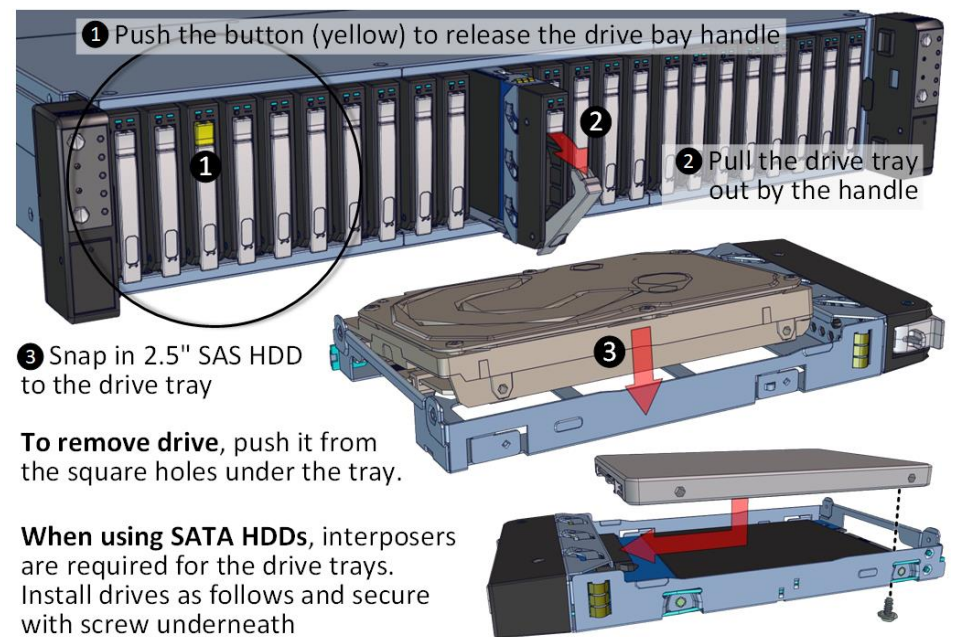

4. Remove the Controller Node to install any components required (IO cards, mezzanine, CPU, memory).

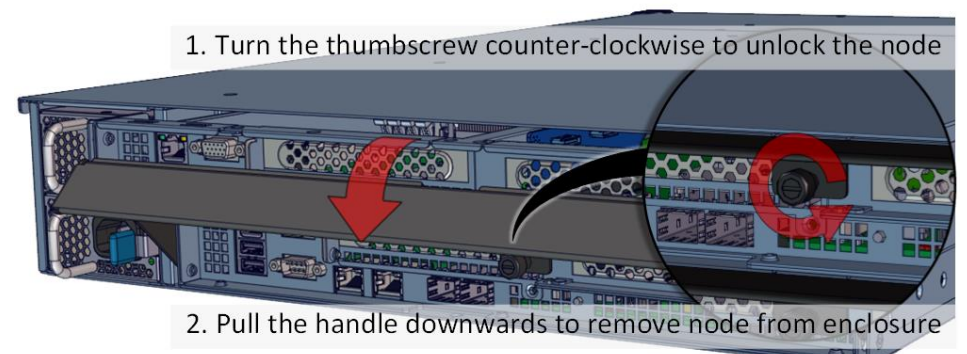

5. Inspect the Controller Node. The components comprise of a Tyan motherboard, an expander board, an optional NTB switch board, power board, 5x internal fan modules (all connected to the motherboard).

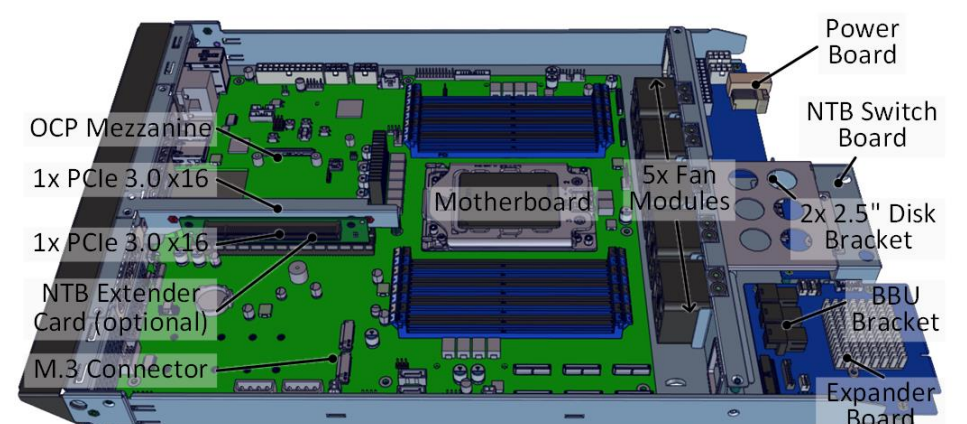


Installation and service of this product should be conducted by a trained personnel to avoid bodily injury from electric shock or heavy object




Observe ESD (Electrostatic Discharge) practices during integration to avoid possible damage to the board and / or other components

6. Install OS disk(s) if required as follows:

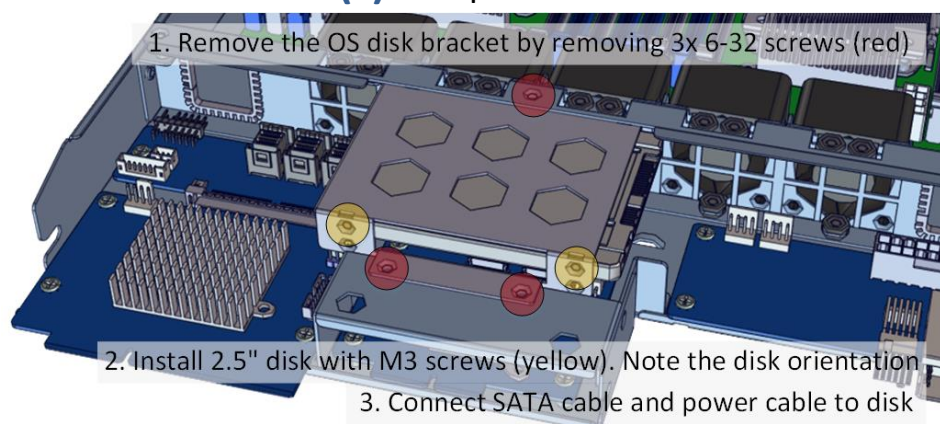


7. Install Motherboard Components (CPU, heatsink, memory) using the guidelines below. For further details, refer to the motherboard TPS.

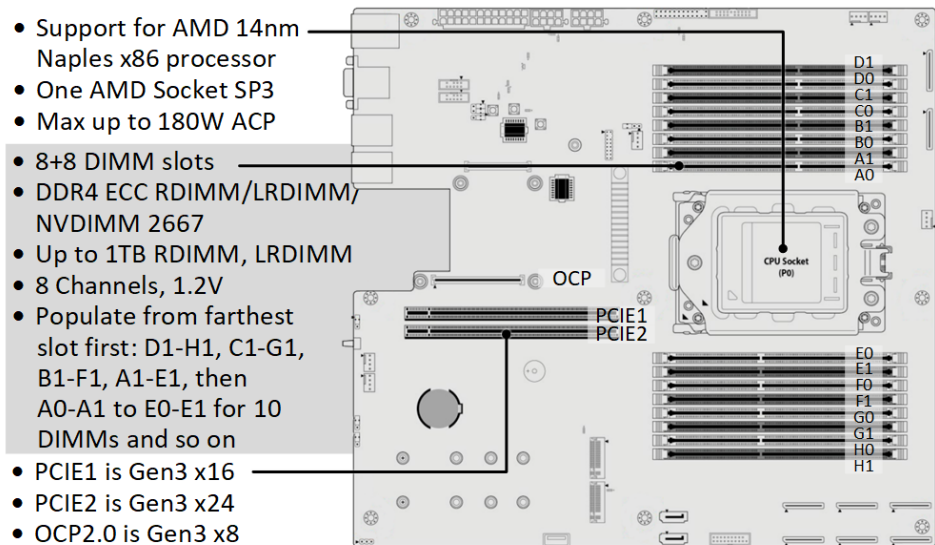


8. Install IO card as guided below:

1. Remove the riser card assembly by removing 3 screws (red circles)

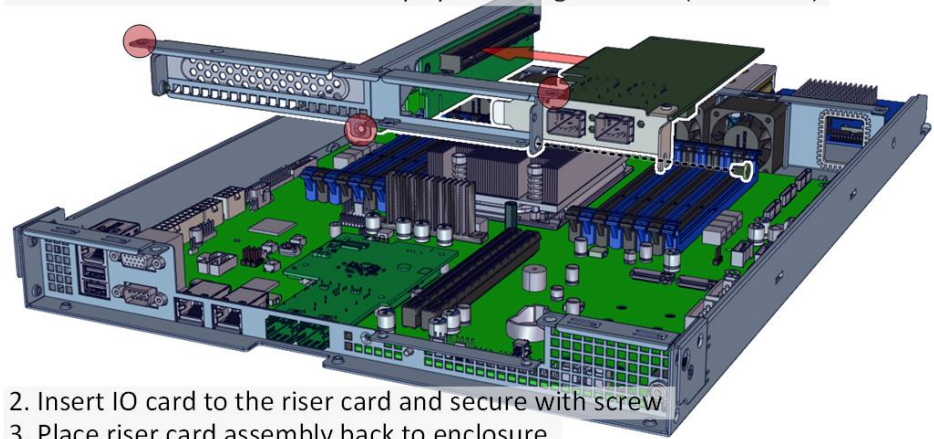


9. Remove the Inner Rail from the slide rail.


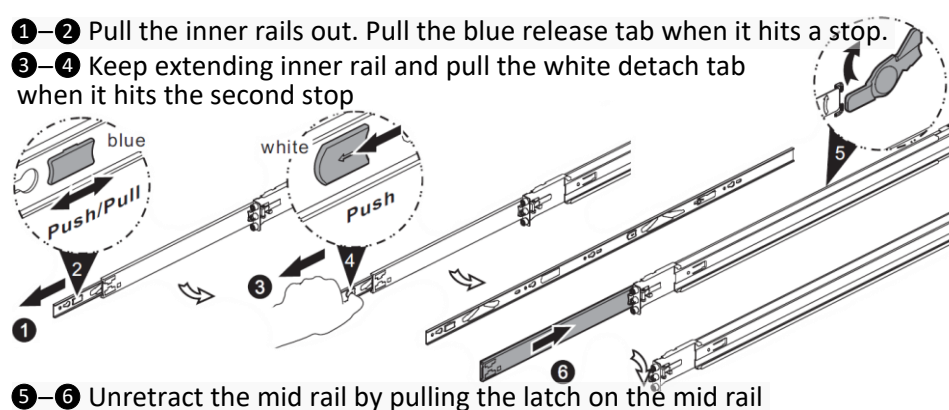


10. Install Inner Rails to the enclosure.


Yellow circles are for standoff screws

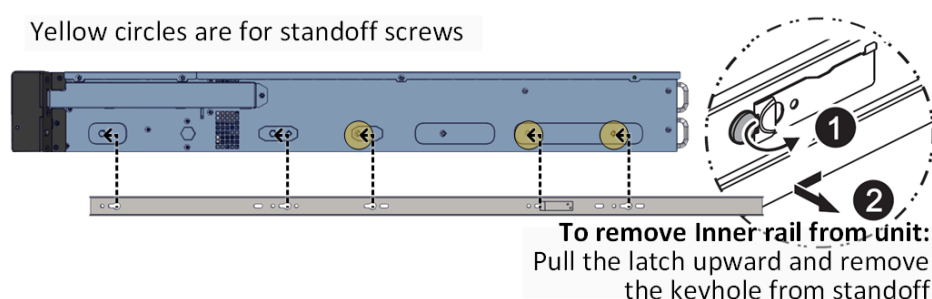


11. Install the Outer Rails to the Rack as follows:

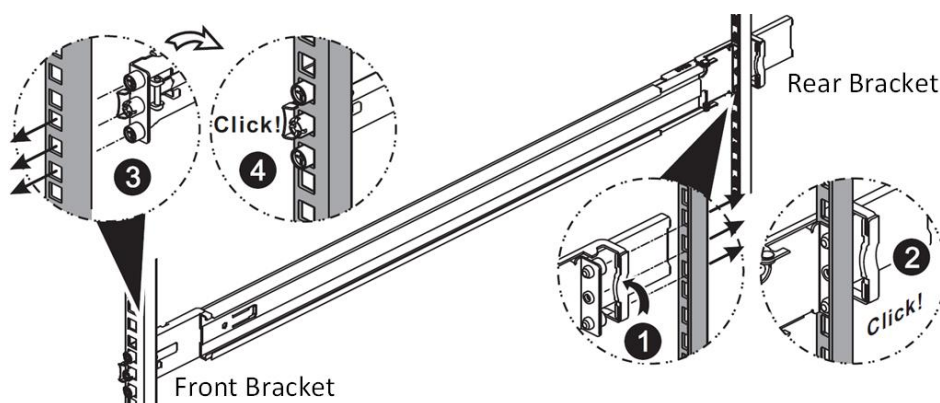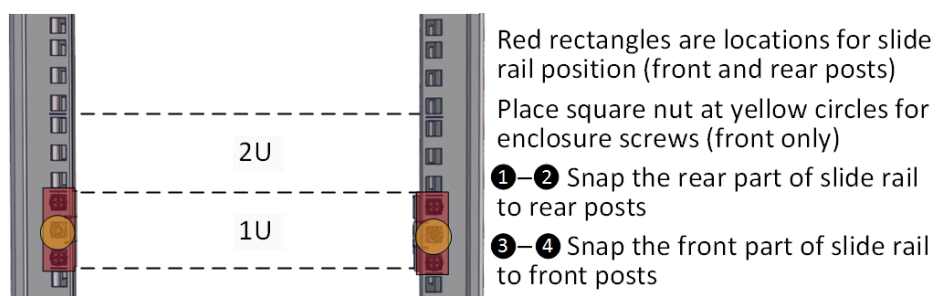

To remove slide rails, use the latches to undo the assembly as follows:

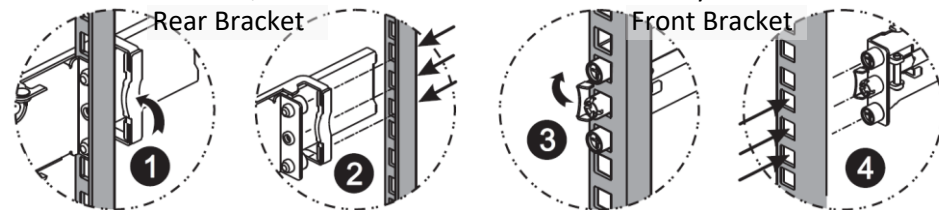

12. Install the Unit to the Rack as follows:

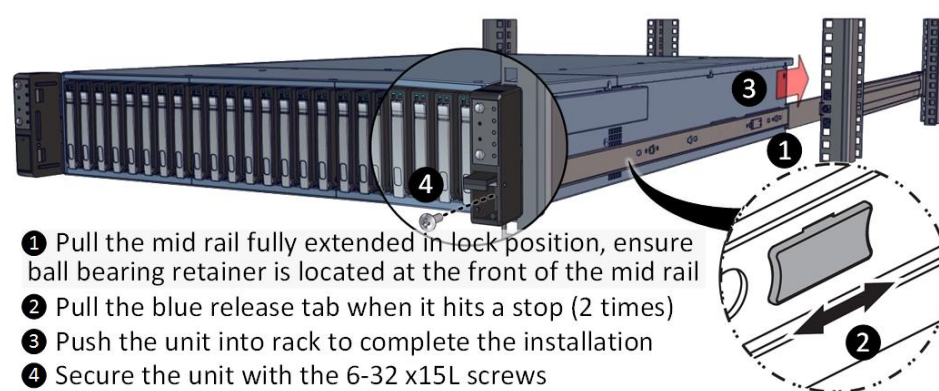

For a complete instruction on how to install unit to the rack, please follow the Slide Rail Installation Guide.




At least two people are recommended for mounting process. Insert HDDs after unit is mounted.

13. Drive Mapping of DSS224S-UN is as follows:



14. Plug in the Power Cords to the AC receptacles on the back of the unit.



15. Press the Power Button on the front of the unit and for the system to boot up. Left panel for primary node, right panel for secondary node.



16. Access the Serial Console (when necessary) by connecting RS-232 serial cable to the one of the console ports. Use a terminal console with baud set 115200, 8, N, 1, N. Refer to User's Manual for further detail and how to set up Ethernet Management Port.

